View NSN Online: https://aerobasegroup.tw/nsn/6525-01-075-8325

EASTMAN KODAK CO -- KODAK RP X-OMAT FIXER & REPLENISHER, PART A -- 6525-01-075-8325

Product ID:KODAK RP X-OMAT FIXER & REPLENISHER, PART A

MSDS Date:10/14/1991

FSC:6525

NIIN:01-075-8325

MSDS Number: BQQHH === Responsible Party ===

Company Name: EASTMAN KODAK CO

Address:343 STATE STREET

City:ROCHESTER

State:NY ZIP:14650 Country:US

Info Phone Num:716-724-4501

Emerge

ncy Phone Num:716-722-5151

CAGE:19139

=== Contractor Identification ===

Company Name: EASTMAN KODAK CO GOVERNMENT MARKETS CONTRACTS

Address:343 STATE ST Box:City:ROCHESTER

State:NY

ZIP:14650-1115 Country:US

Phone:716-722-5151/(800) 242-2424

CAGE:19139

====== Composition/Information on Ingredients ========

Ingred Name:WATER

CAS:7732-18-5

RTECS #:ZC0110000 Fraction by Wt: 40-45%

Other REC Limits: NONE SPECIFIED

Ingred Name: AMMONIUM THIOSULFATE

CAS:7783-18-8

RTECS #:XN6465000

Fractio

n by Wt: 35-40%

Other REC Limits: NONE SPECIFIED

Ingred Name: SODIUM THIOSULFATE

CAS:7772-98-7

RTECS #:XN6476000 Fraction by Wt: 10-15%

Other REC Limits: NONE SPECIFIED

Ingred Name: AMMONIUM ACETATE (SASA III)

CAS:631-61-8

RTECS #:AF3675000 Fraction by Wt: 1-5%

Other REC Limits: NONE SPECIFIED

OSHA PEL:5 MG/M3

ACGIH TLV:5 MG/M3; 9192 EPA Rpt Qty:5000 LBS DOT Rpt Qty:5000 LBS

Ingred Name: AMMONIUM BISULFITE (SARA III)

CAS:10192-30-0 RTECS #:WT3595000 Fraction by Wt: 1-5%

Other REC Limits: NONE SPECIF

IED

EPA Rpt Qty:5000 LBS DOT Rpt Qty:5000 LBS

Ingred Name:SODIUM BISULFITE (SASA III)

CAS:7631-90-5

RTECS #:VZ2000000 Fraction by Wt: 1-5%

Other REC Limits: NONE SPECIFIED

OSHA PEL:5 MG/M3 ACGIH TLV:5 MG/M3; 9192 EPA Rpt Qty:5000 LBS DOT Rpt Qty:5000 LBS

Ingred Name: SODIUM ACETATE

CAS:126-96-5


RTECS #:AJ4375000 Fraction by Wt: 1-5%

Other REC Limits: NONE SPECIFIED

========== Hazards Identification ===========================

LD50 LC50 Mixture:LD50 (ORAL RAT) IS NOT ESTABLISHED.

Routes o

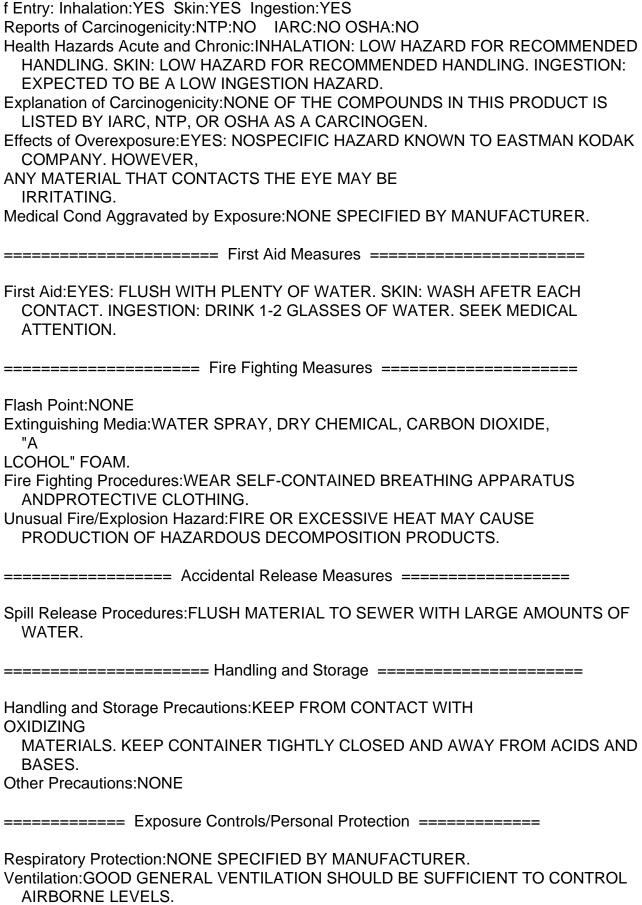

Protective Gloves: YNONE SPECIFIED BY MANUFACTURER. NEOPRENE Eye Protection: SAFETY GLASSES SHOULD BE WORN.

Other Protective Equipment: EYE WASH STATION AND SAFETY SHOWER.

Work

Hygienic Practices:OBSERVE GOOD PERSONAL HYGIENE PRACTICES AND RECOMMENDED PROCEDURES.
Supplemental Safety and Health

KEY1:C3. THIS IS A 2-PART KIT. FORMULA CHANGED. SEE PNI A FOR PREVIOUS FORMULATION. TYPICALLY 10 ROOM VOLUMES PER HOUR IS CONSIDERED GOOD GENERAL VENTILATION: VENTILATION RATES SHOULD BE MATCHED TO CONDITIONS OF USE.

======== Physical/Chemical Properties ===========

HCC:C3

Boiling Pt:B.P. Text:>212F,>100C

Vapor Pres:18 @20C Vapor Density:0.6

AIR=1

Spec Gravity:1.361

pH:4.10

Solubility in Water: COMPLETE

Appearance and Odor: COLORLESS SOLUTION; SLIGHT AMMONIA ODOR.

Percent Volatiles by Volume:45

======== Stability and Reactivity Data ==========

Stability Indicator/Materials to Avoid:YES
STRONG OXIDIZING AGENTS, STRONG ACIDS, STRONG BASES
Stability Condition to Avoid:NONE SPECIFIED BY MANUFACTURER.
Hazardous Decomposition Products:CARBON DIOXIDE AND PROBABLY CARBON MONOXIDE AS WELL AS AMMONIA AND OXIDES OF SULFU R AND NITROGEN.

====== Disposal Considerations ============

Waste Disposal Methods:DISCHARGE, TREATMENT, OR DISPOSAL MAY BE SUBJECT TO FEDERAL, STATE AND LOCAL LAWS.

Disclaimer (provided with this information by the compiling agencies): This information is formulated for use by elements of the Department of Defense. The United States of America in no manner whatsoever, expressly or implied, warrants this information to be accurate and disclaims all liability

for its use. Any person utilizing this document should seek competent professional advice to verify and assume responsibility for the suitability of this information to their particular situation.